College Lake Project Construction Photos
Board of Directors Meeting
8-21-2024

College Lake Level Today 8/21/24

Weir Looking South & Looking North from Adjustable Gate 8/20/24

Pump Station Deck Forming 8/15/24

Pump Station Deck Forms Finished & Rebar installed, Concrete Friday

Treatment Plant to Weir Grading Over Raw Water Pipeline, 8/20/24

Concrete Pour at Ballasted Flocculation Tank Foundation Last Week

Hydrostatic Testing Chemical Containment Structure

Ballasted Flocculation Tank Foundation This Week, Another Layer Of Rebar & Another Concrete Pour

Duct Banks Heading Toward Treatment Support Building

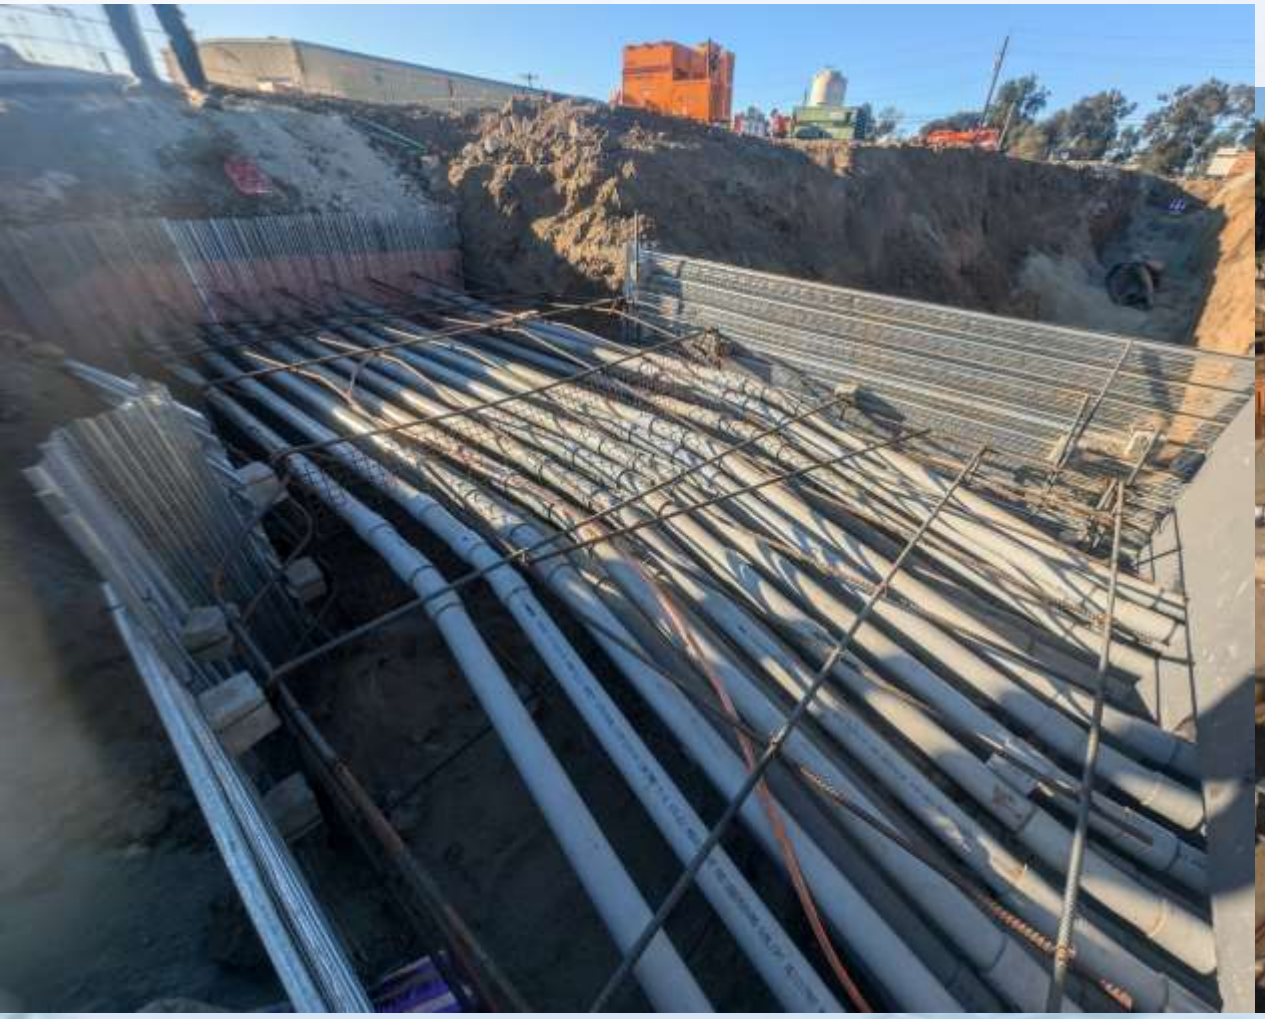

Treated Water Pump Station Sealing and Painting

Bore Pit and Receiving Pit for Salsipuedes Bore

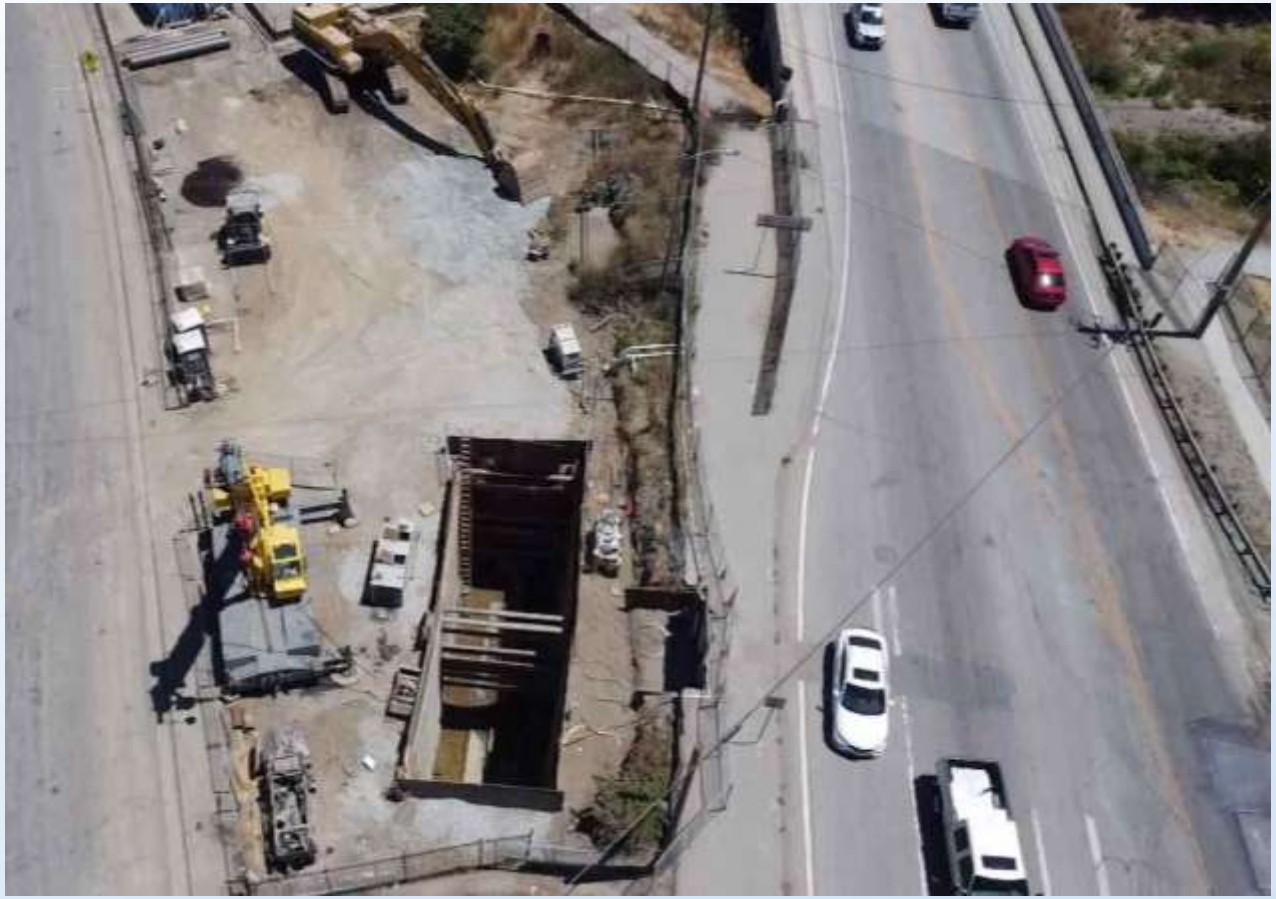

Launch Pit, Auger Machine, July 19, 2024

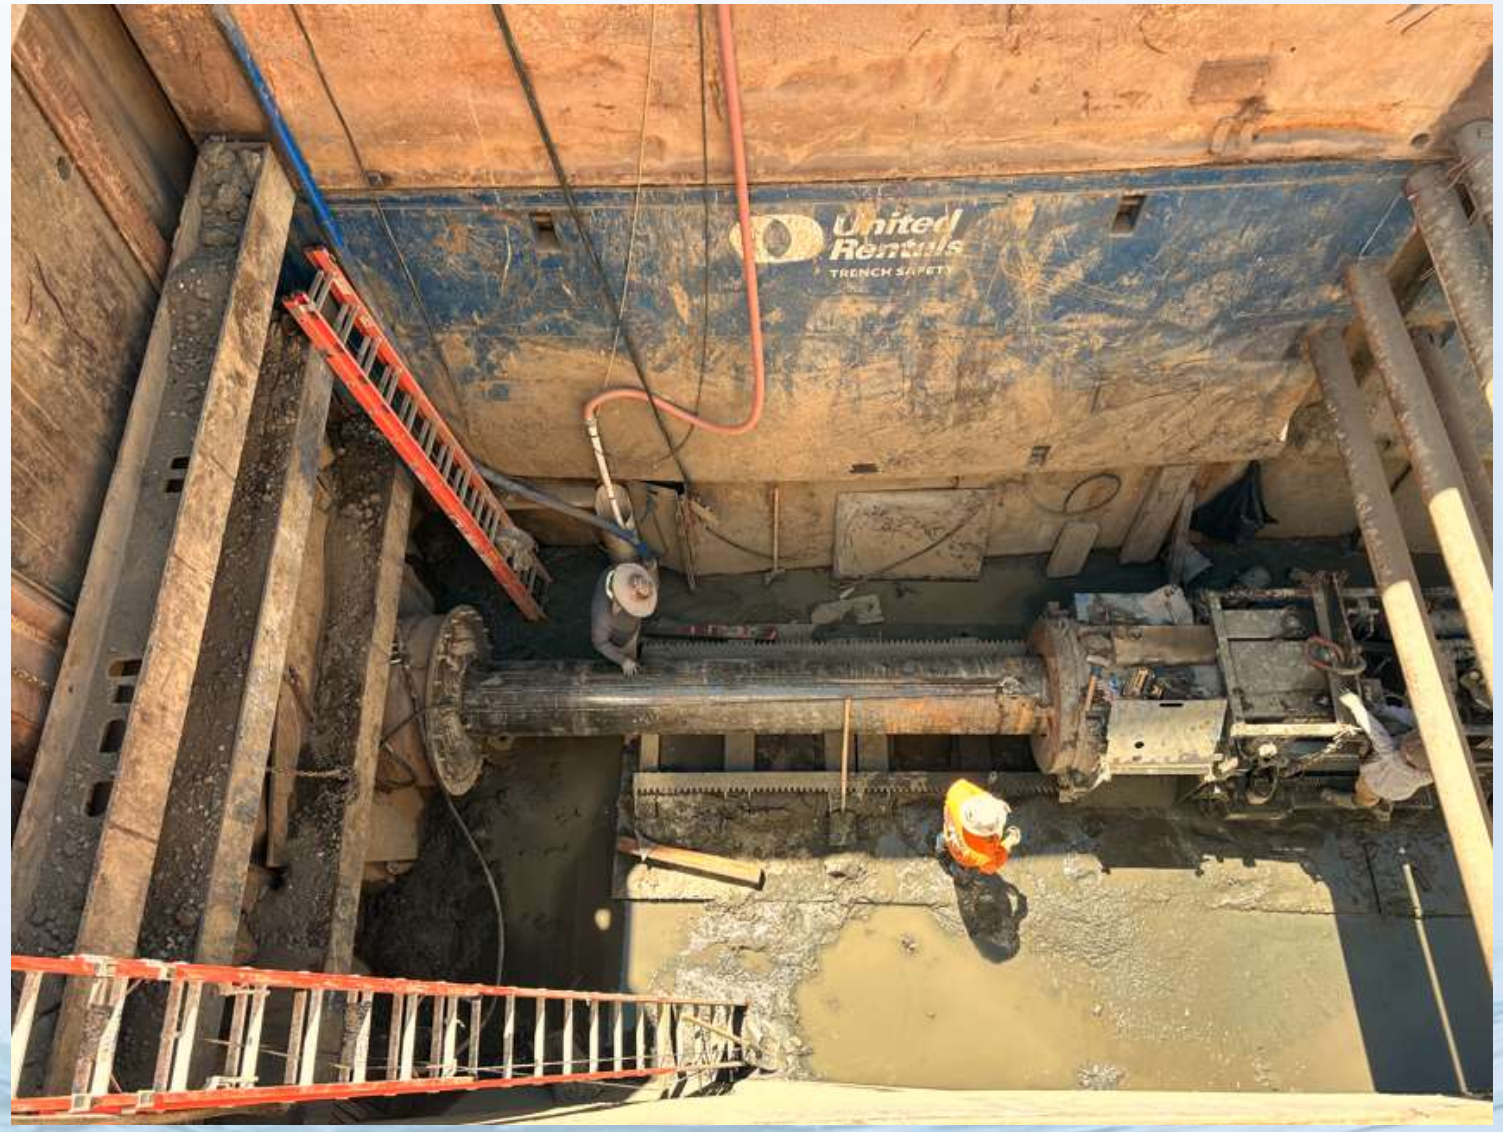

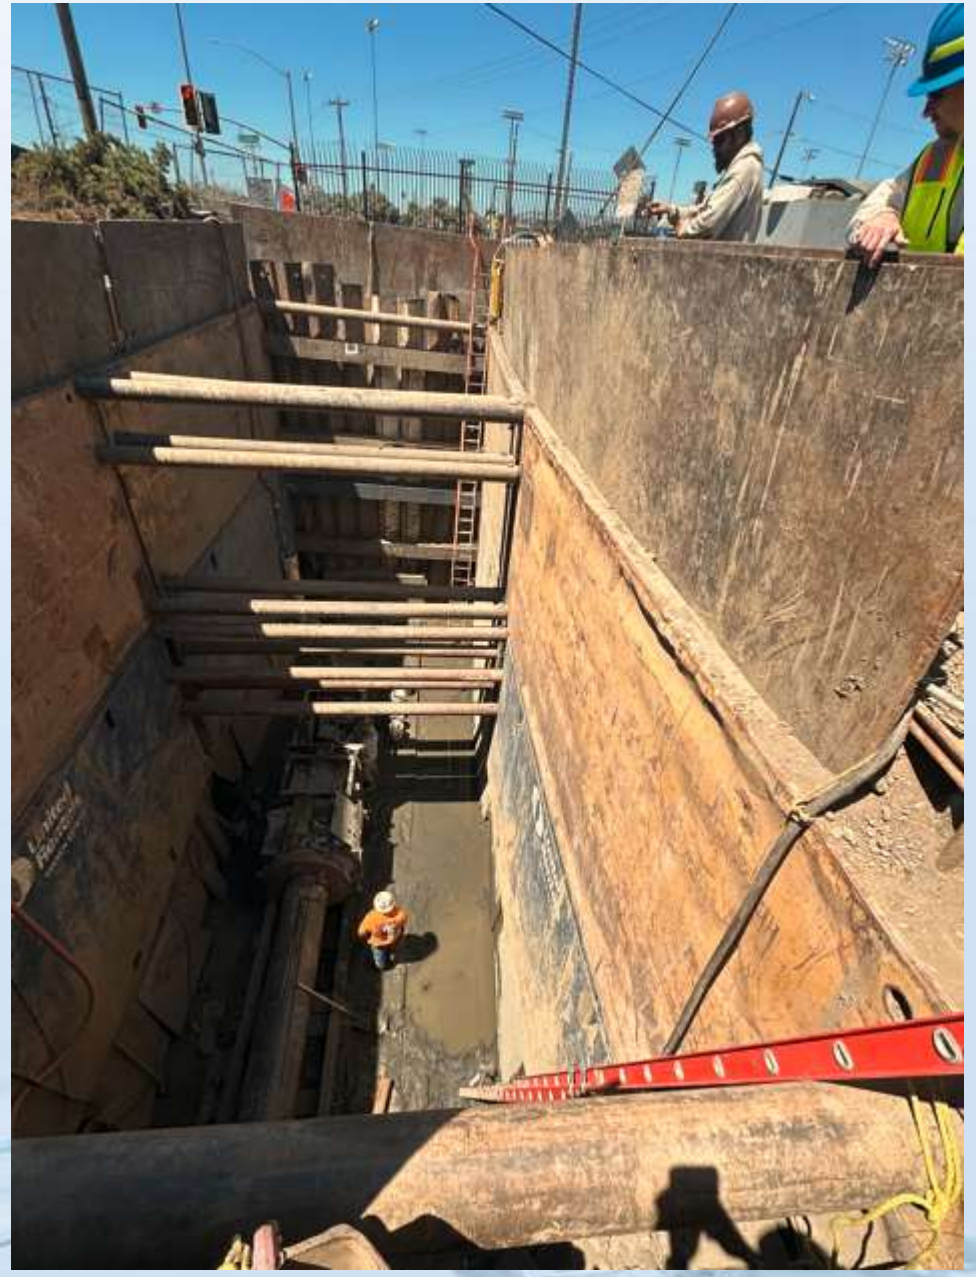

Sinkhole, July 19, 2024

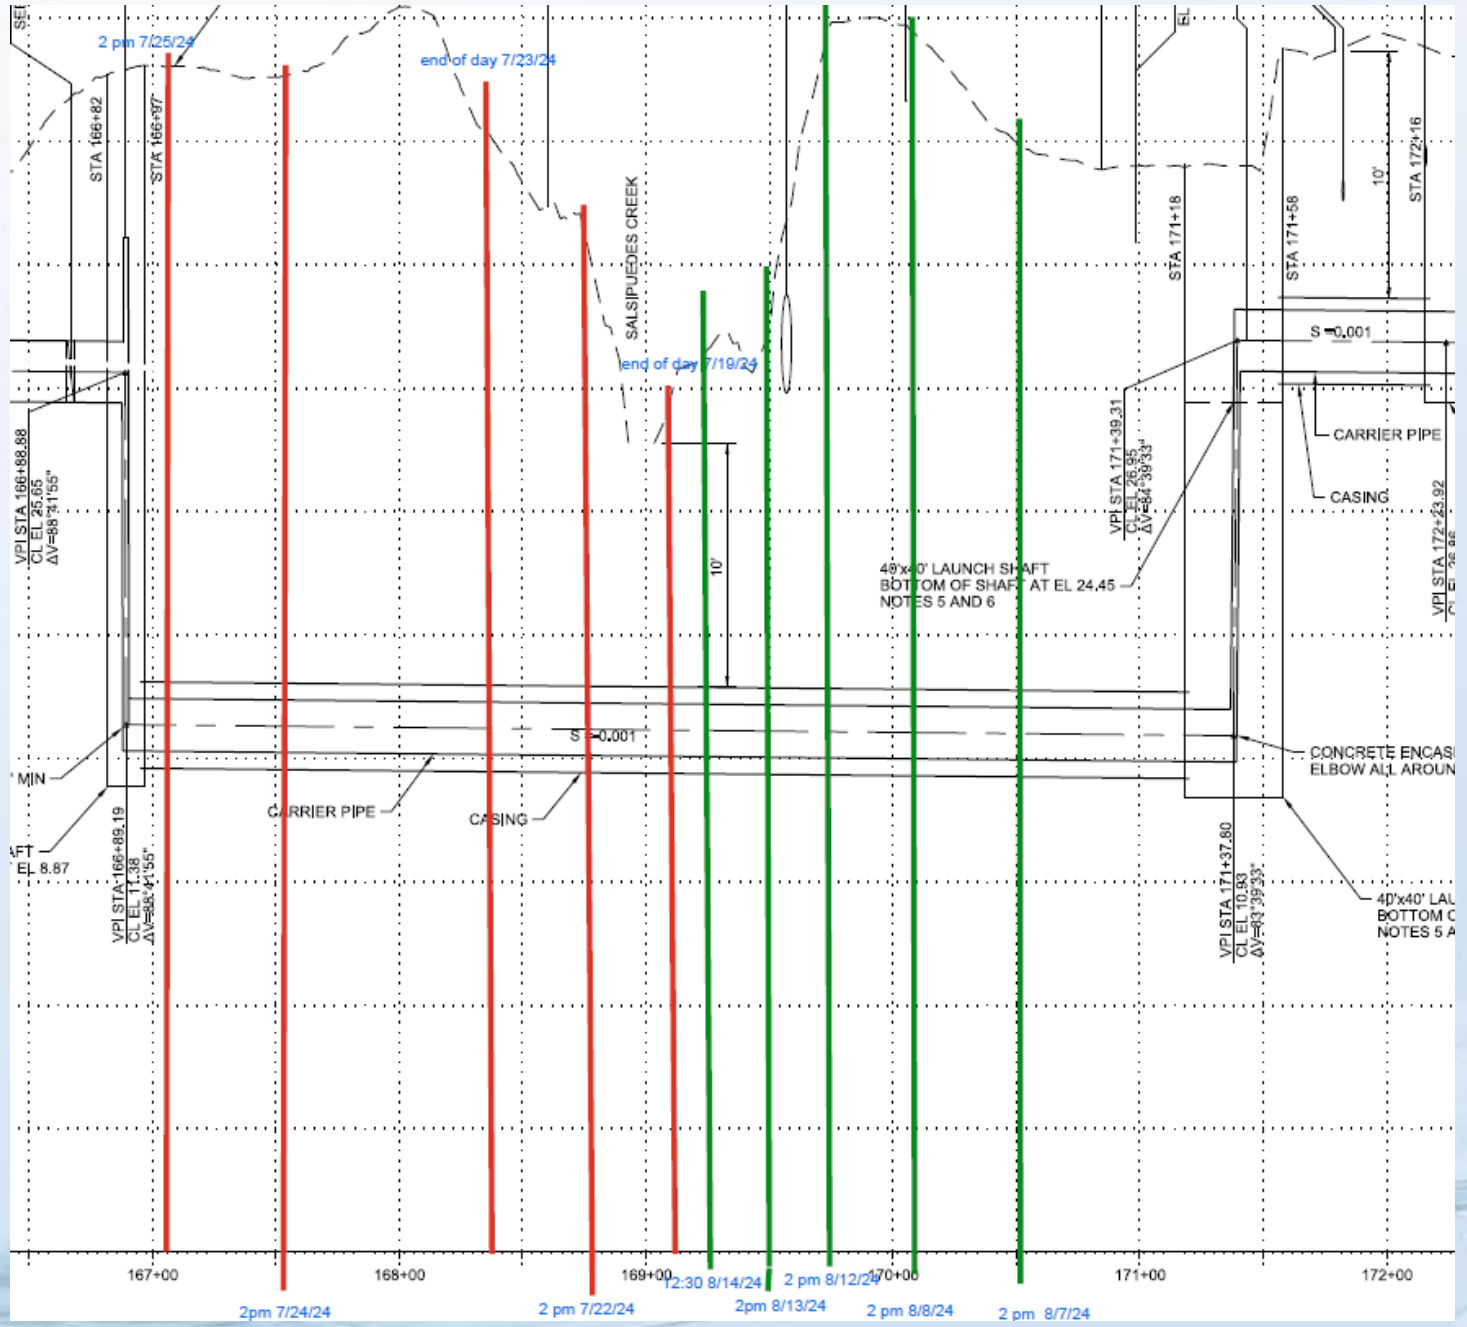
2 pm 7/25/24
end of day 7/23/24
SALSIPUEDES CREEK
end of day 7/19/24
STA 166+82
STA 166+97
STA 171+18
STA 171+58
STA 172+16
10'
S =0.001
CARRIER PIPE
CASING
40'x40' LAUNCH SHAFT
BOTTOM OF SHAFT AT EL 24.45
NOTES 5 AND 6
VPI STA 166+88.88
CL EL 25.65
ΔV=88°41'55"
VPI STA 166+89.19
CL EL 11.38
ΔV=88°41'55"
VPI STA 171+39.31
CL EL 26.95
ΔV=84°39'33"
VPI STA 171+37.80
CL EL 10.93
ΔV=93°39'33"
VPI STA 172+23.92
EL 8.87
MIN
CONCRETE ENCAS
ELBOW ALL AROUN
40'x40' LAU
BOTTOM O
NOTES 5 A
167+00
168+00
169+00
170+00
171+00
172+00
2pm 7/24/24
2 pm 7/22/24
12:30 8/14/24
2pm 8/13/24
2 pm 8/12/24
2 pm 8/8/24
2 pm 8/7/24

Ramming Machine Arrived & Deployed Today

Discovery of Artifacts

Tour Regional Water Quality Control Board Staff, August 21, 2024

CONSTRUCTION COST UPDATES

College Lake Project – Construction Costs

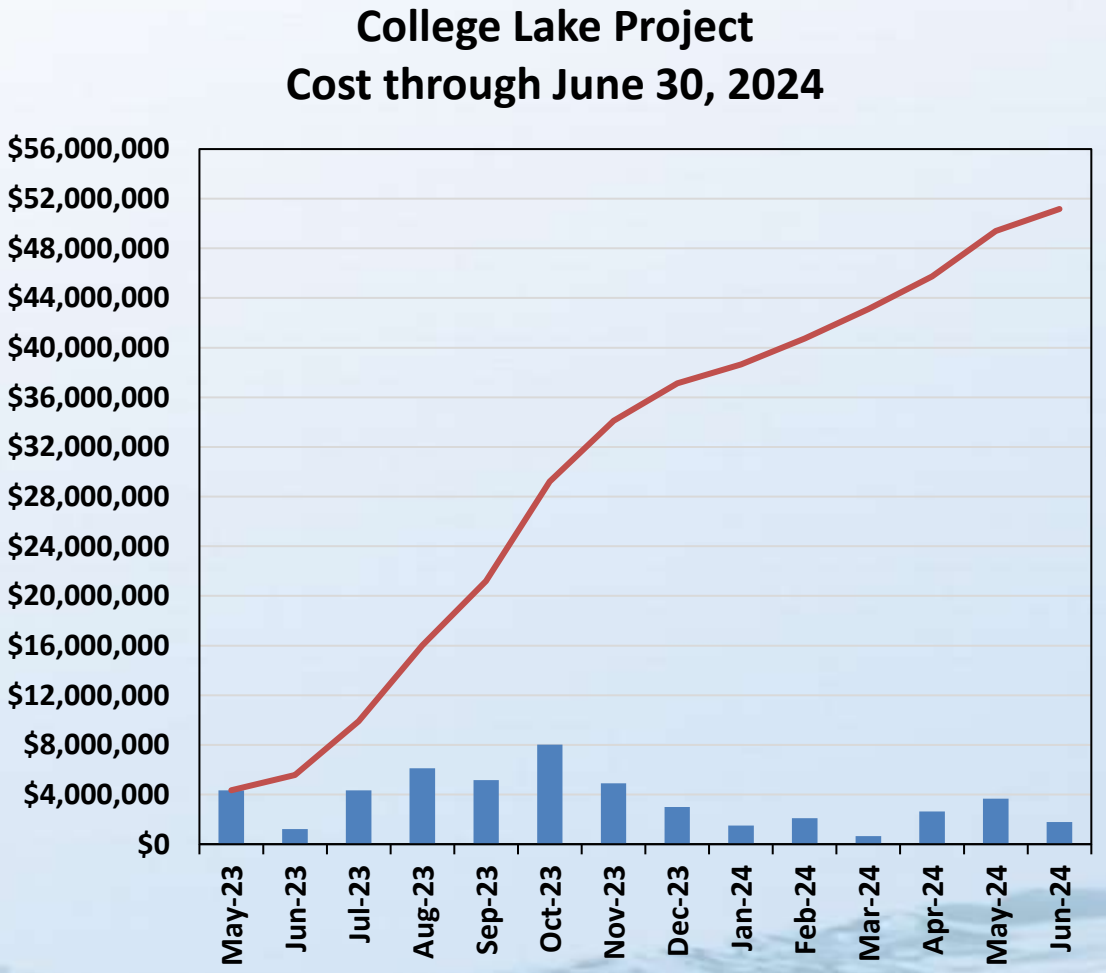

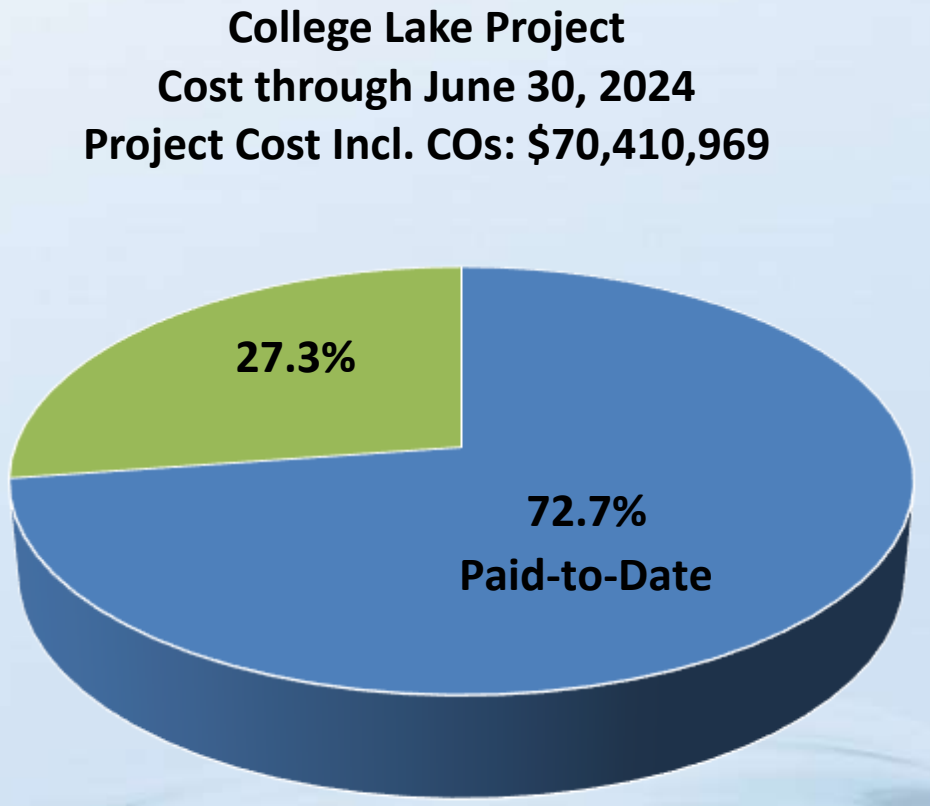

Water Treatment Plant & Intake Facilities Project

WTP & Intake Facilities
Cost through June 30, 2024

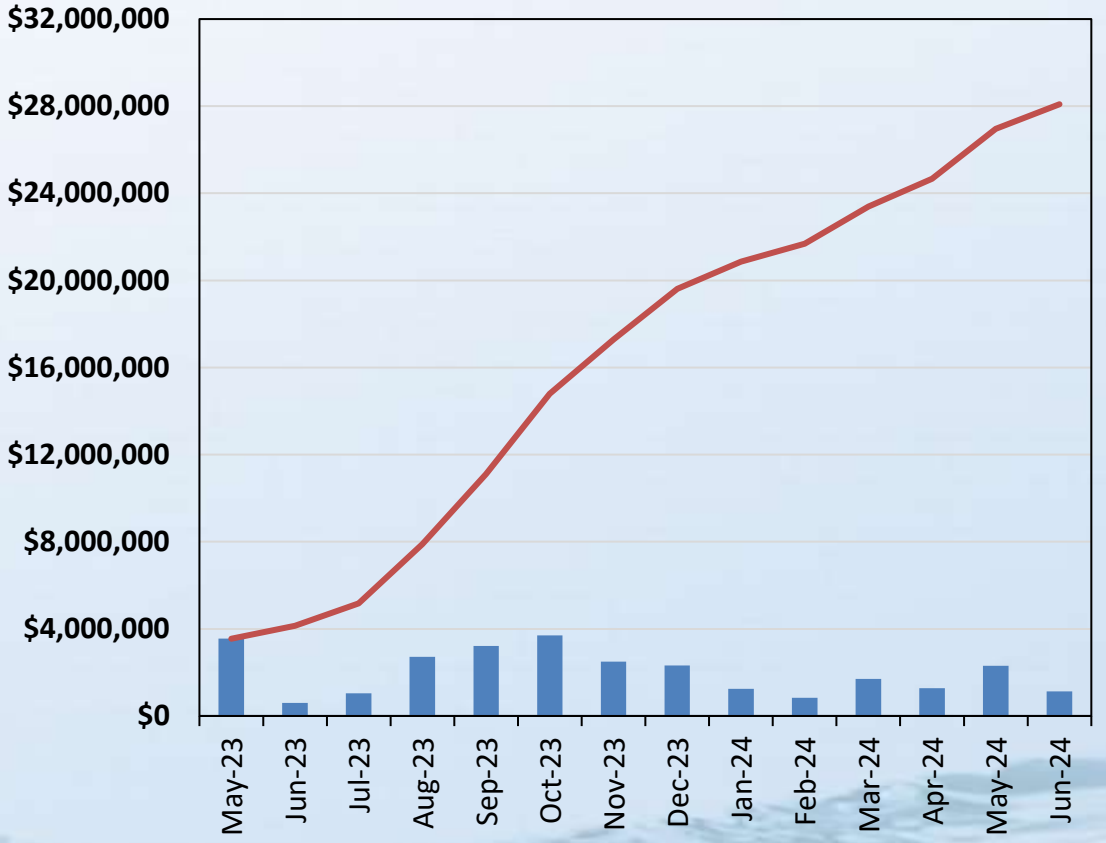

WTP & Intake Facilities
Cost through June 30, 2024
Project Cost Incl. COs: $45,658,688

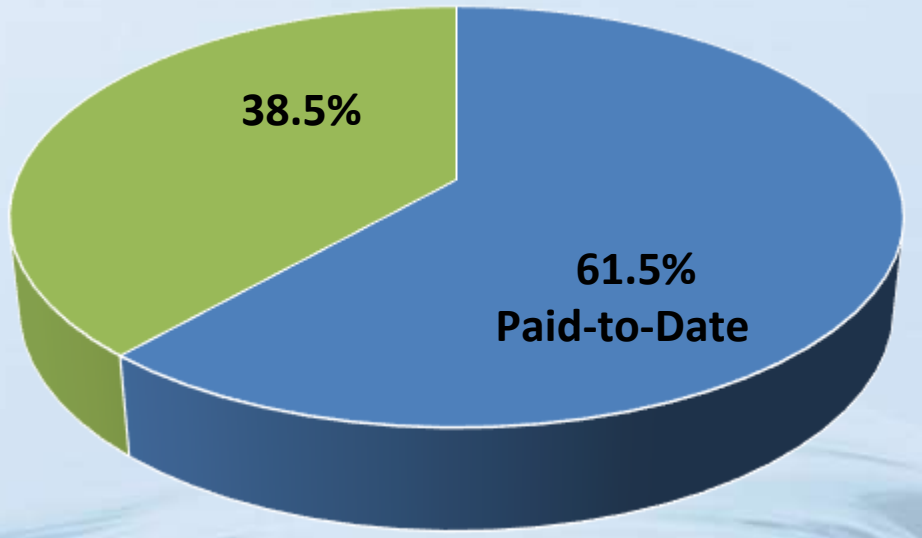
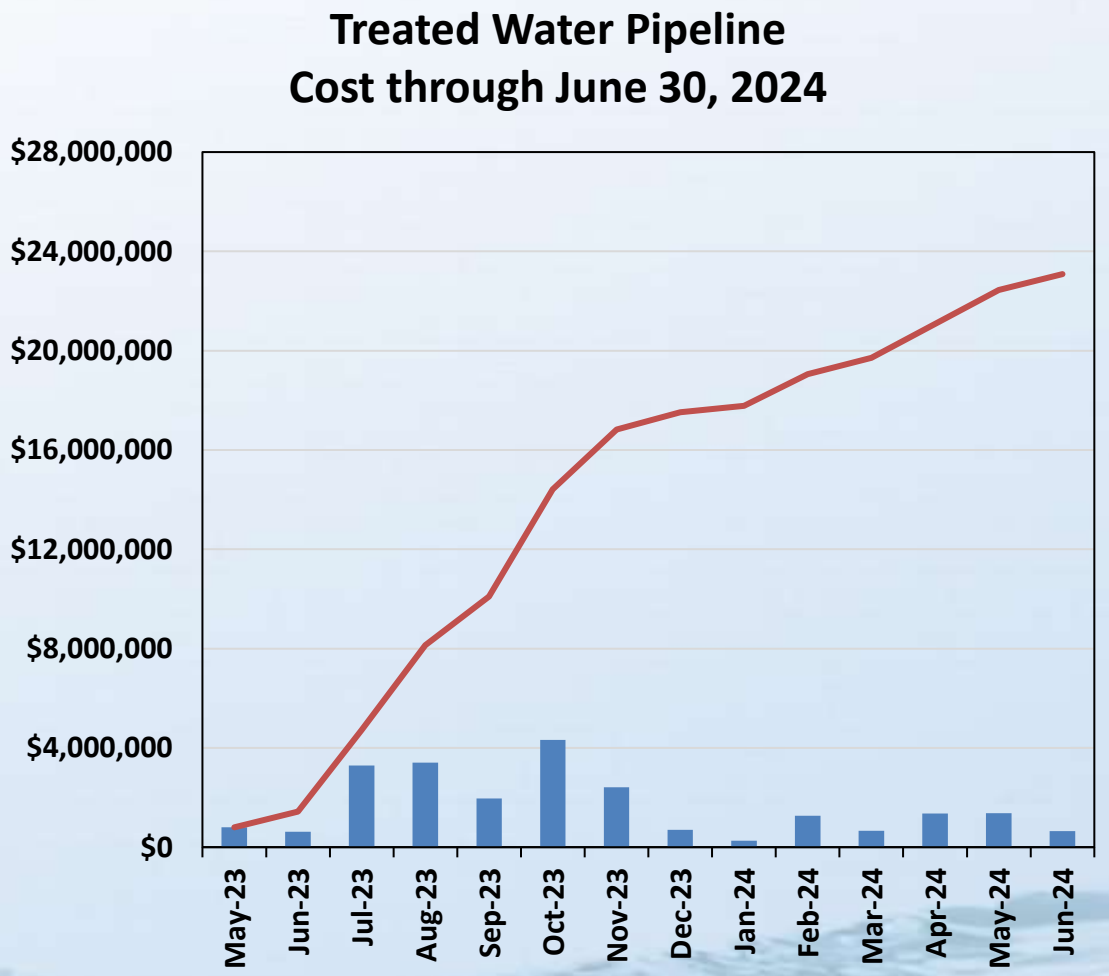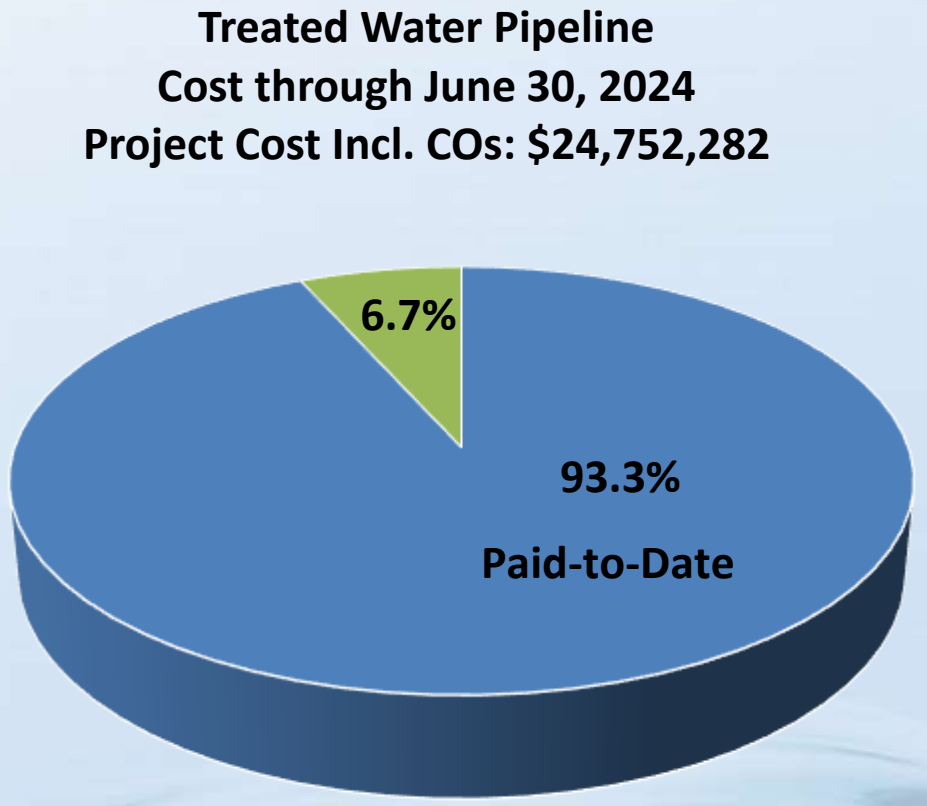
Treated Water Pipeline Project